

Code Evaluation Research Report

Report Holder:

Vault Structures, Inc.
3640 Work Drive
Fort Meyers, Fl 33916
(239) 332-3270
www.vaultstructures.com

3.0 Description:

3.1 Model

DS-450 Customer Unit kiosk

Evaluation Subject:

Motor Banking Customer Unit Model DS-450

3.2 General

This unit is a steel encased mechanical receiving station for a delivery system using a pneumatic tube system. The system sends a carrier between this unit and the teller station.

1.0 Evaluation Scope:

1.1 Code Evaluation Criteria:

1.1.1 2004 Florida Building Code (2004 FBC) with 2005 and 2006 supplements

3.3 Unit Nominal Overall Dimensions:

Length: 22" (55.9 cm)
Width: 8.5" (21.6 cm)
Height: 61" (154.9 cm)

1.1.2 Minimum Design Loads for Building and other structures, ASCE 7-02

1.1.3 Florida Product Rule 9B-72

3.4 Components:

3.4.1 Stanchion Unit – Base of unit:

Material: Steel
Yield Strength: 50 ksi minimum
(3.45×10^8 n/m²m)
Thickness: 11 Gauge (3.04 mm)
Length: 16" (40.6 cm)
Width: 8 5/8" (14.3 cm)
Height: 36 1/2" (92.7 cm)

1.2 Properties Evaluated:

Structural attachment to concrete support.

3.4.2 Anchor:

Manufacturer: Hilti Inc. (USA)
Model: Kwik Bolt III
Item Number#: 282545
Material: Stainless Steel
Diameter: 3/8" (9.5 mm)
Length: 5" (12.7 cm)
Miami-Dade NOA#: 06-0813.13

1.3 Quality Assurance Program:


Quality Assurance program review

1.4 Product Approval Scope Analysis

Determine applicability within scope definitions

2.0 Evaluated Uses:

A free standing, exterior, unoccupied, mechanical structure.



Code Evaluation Research Report

3.4.3 Concrete Support:

Material: Concrete
Compressive Strength
Minimum : 3000 psi (2.07 x 10⁷ n/m²)
Thickness: 6" Minimum (15.2cm)

(Design of concrete support not part of this evaluation)

4.0 Installation:

1. The unit shall be attached to the concrete Support with a minimum of Four (4) anchors.
2. Place Stanchion Unit onto concrete covering hole for pneumatic tube and wiring.
3. Drill 3/8" (9.5 mm) Diameter holes in concrete at location of holes in stanchion.
4. Hilti Kwik Bolt III Anchors shall have a minimum embedment of 3 3/4" (9.5 cm) and an minimum edge distance of 2 1/2" (6.4 cm)
5. Clean Drill hole
6. Place Hilti Kwik Bolt III into hole.
7. Tap in place so that six threads are below surface of stanchion.
8. Tighten bolt.

Refer to the Manufacturer's installation instructions for a supplemental guide.

5.0 Findings:

5.1 Structural Properties:

This unit is designed to be attached to a concrete support.


The unit attachment shall comply with 2004 Florida Building Code (with 2005 and 2006 supplements) Section 1609.1 (Minimum Wind Loads for Structures), and Mechanical Code Section 301.13 per criteria listed in Florida Building Commission Interim Clarification of 301.13, Notice #2, Dated February 12, 2002.

The unit installed per section 5.0 will resist wind loads per the following ASCE 7-02 design criteria:

Basic Wind Speed	150 mph (241.4 kph)
Region:	Hurricane prone zone
Terrain Exposure :	C
Maximum Elevation:	15 feet (4.57 m)
Category:	I
Importance Factor:	0.87
Topographic Factor:	1.0
Directionality Factor:	1.0
Gust Factor:	0.85

5.2 Quality Assurance Program:

Vault Structures has a Production Quality Assurance Program that addresses incoming materials documentation, production quality, inspection and unit testing. Shipping documentation is maintained in the job files. The Quality Assurance Program compliance is the responsibility of the named primary Quality Control Officer, Robert Straka.



Code Evaluation Research Report

5.3 Florida State Product Approval:

5.3.1 Florida Product Approval Scope:

The Florida mandatory Product Approval system is limited to products and systems which comprise the building envelope and structural frame for compliance to the structural requirements of the Florida Building Code per rule 9B-72.005.

5.3.2 Florida Product Approval Scope Analysis:

The DS-450 as evaluated for use as a free standing exterior, unoccupied, mechanical structure as listed in section 2.0 of this report and is not integral to the building envelope. This structure is outside of the scope of the Florida Product Approval per Rule 9B-72.005 and does not meet the criteria for a Florida State Product Approval.

5.3.3 Miami-Dade Notice of Acceptance (NOA) Scope:

Building Products used in Dade or Broward counties (The Geographically Designated High-Velocity Hurricane Zone) that protect the envelope of the building from being breached must be approved by the Building Code Compliance Office, Product Control Division.

5.3.4 Miami-Dade Notice of Acceptance (NOA) Findings:

Model DS-450 Customer Unit as evaluated for use as a free standing structure is not part of the building envelope and therefore as such is outside of the scope of Miami-Dade’s Product Control Division’s criteria. This structure does not meet the criteria for a Miami-Dade Notice of Acceptance product Approval.

6.0 Conditions of Use:

6.1 DS-450 is to be installed in accordance with section 4.0 Installation.

6.2 DS-450 is evaluated to resist vertical uplift, horizontal sliding, and overturning wind loads.

6.3 This unit is evaluated to resist the wind pressure criteria at a maximum elevation above ground (measured to the top of the unit) of 15 feet. (4.57 m)

7.0 Referenced Documents:

7.1 Manufacturers Documentation

7.1.1 Unit specifications

7.1.2 Installation Instructions

7.2 Anchor Documentation

7.2.1 Hilt 2006 North American Product Technical guide.

7.2.2 Miami-Dade Notice of Acceptance #06-0810.13 for Hilti Kwik Bolt III.

7.3 Engineering Report

CBUCK Engineering report C07-108-VS

7.4 Quality Assurance Program Documentation

Vault Structures Production Quality Assurance Manual

Code Evaluation Research Report

8.0 Identification:

Each Vault Structures, Inc., DS-450 Unit is identified with a metal label bearing the manufacturers name, location, date, model and serial numbers

9.0 Use of Report for Code Compliance:

9.1 2004 Florida Building Code (FBC) Section 104.11.1 allows Research Reports to provide supporting data for demonstrating code compliance of materials or assemblies.

9.2 Evaluation of the subject of this Code Evaluation Research Report was performed through approved testing and engineering analysis to demonstrated compliance with the intent of the referenced code sections and standards listed in this report. Building Officials, having jurisdiction, are granted the duty and power through state statue to confer approvals for all material and assemblies through the permit process for specific projects based on the design use of products and methods per FBC Section 104. (Exception: Florida State approved mandatory envelope products that are being used within their limits of use per Rule 9B-72)

9.3 CBUCK Engineering and James L Buckner, P.E are independent third parties from the Report Holder and do not have or intend to have a financial interest in the Report Holder.


9.4 Code Evaluation Research Reports shall not be used to infer an endorsement by CBUCK Engineering or James L. Buckner, P.E. of the manufacturer or product.

9.5 Current Code Evaluation Research Reports are posted and viewable on CBUCK Engineering's website at www.cbuckinc.net.

Contents: Pages 1 - 6


The scope of this certification is limited by the report criteria and conditions.

Board Certified Structural Engineer
SECB # 1058-0705
Florida Registered Evaluation Engineer.
FBC ANE #1916

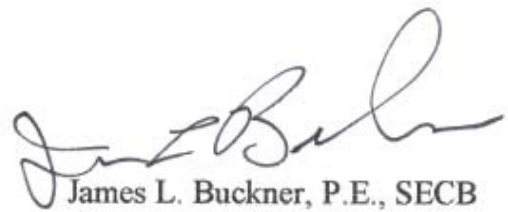

James L. Buckner, P.E., SECB
Florida P.E. # 31242
11/12/07


**Vault Structures
Motor Banking Customer Unit
Model DS-450**

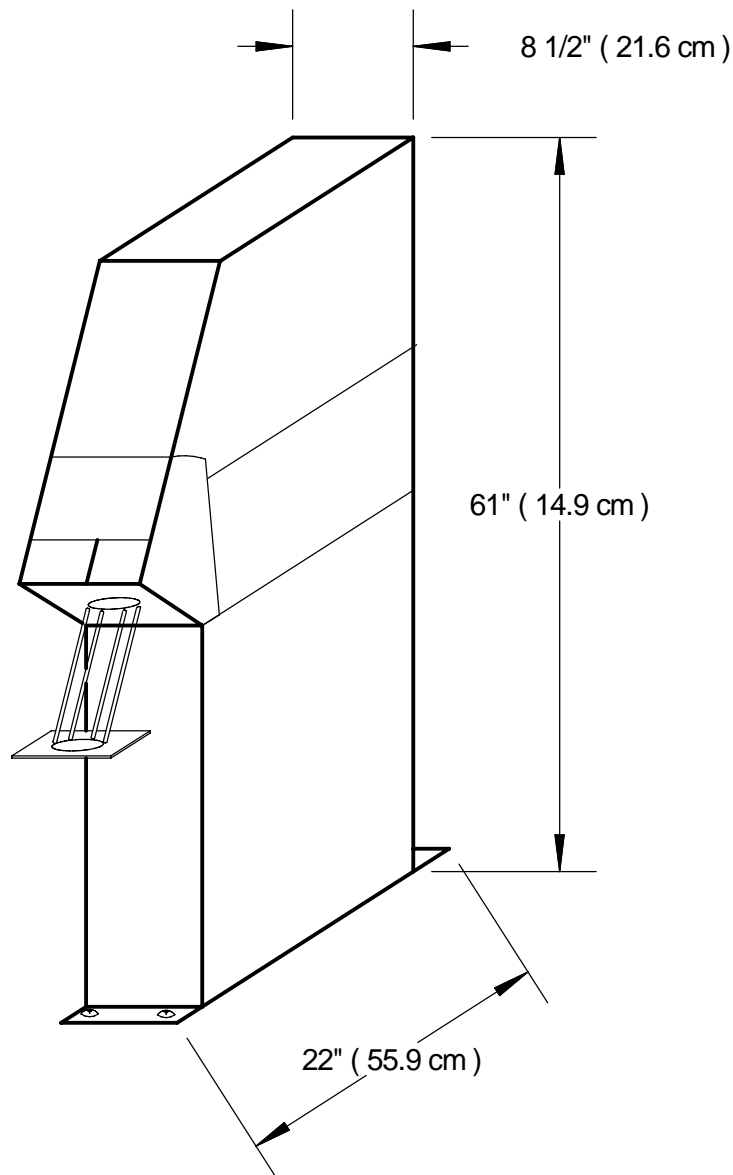

**Unit Nominal Overall Dimensions
Vault Structures
Motor Banking Customer Unit
Model DS-450**

Anchor:

Manufacturer : Hilti
Model: Kwik Bolt III
Item #: 282545
Diameter: 3/8" (9.5 mm)
Length: 5" (12.7 cm)
Edge Distance 2 1/2" (6.4 mm)
Minimum

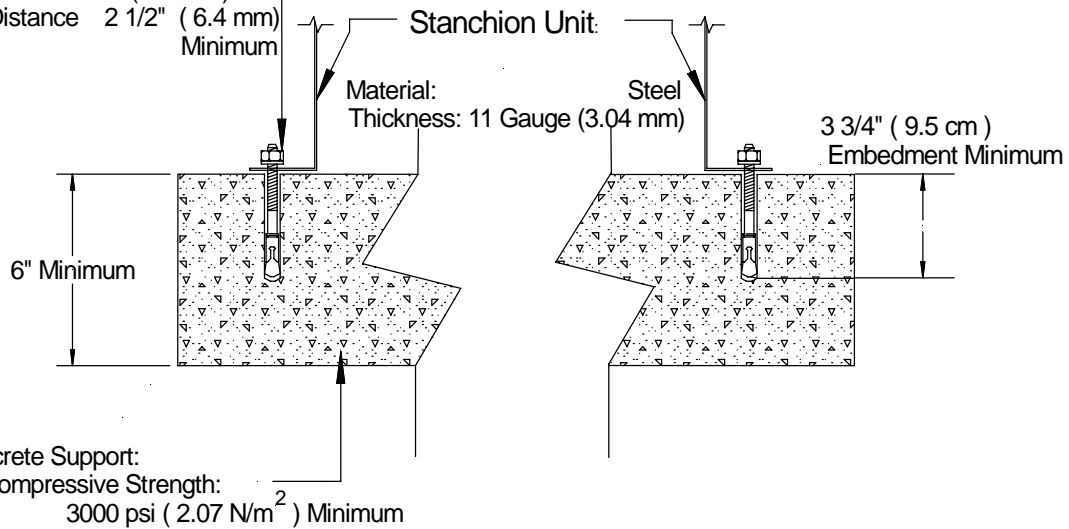

Side Section